


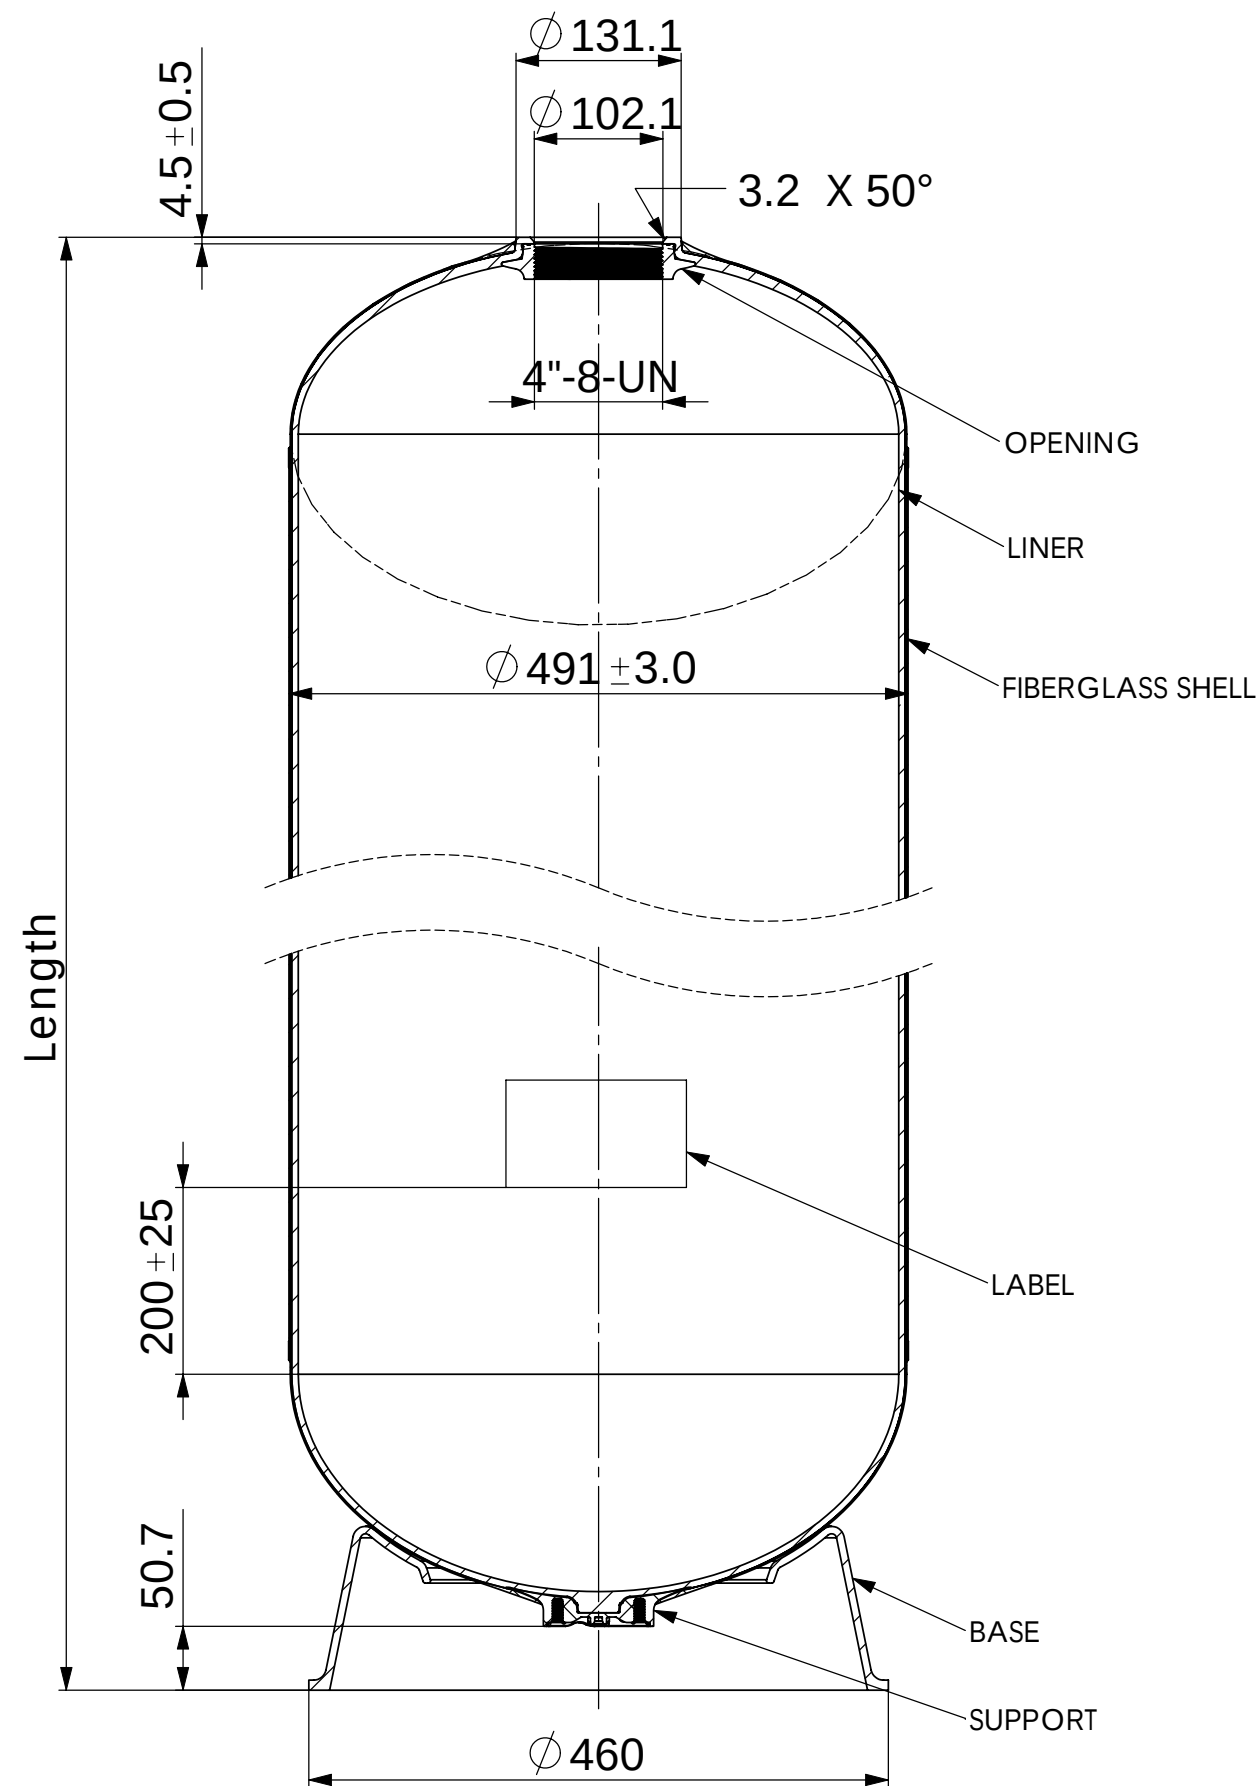

MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
18×36	1000	39.4	4	138	4.88	19.4	42.68
18×53	1432	56.4	5	211	7.46	24.8	54.6
18×65	1722	67.8	6	257	9.08	28.1	61.8

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIRMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

				開能 CANATURE GROUP			
				18" FRP PRESSURE VESSEL (4"-8-UN Opening)			
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE REMARK		NUMBER /SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION		SOURCING FROM:		
TECHNOLOGIST			TOTAL PAGES:		PAGE NO.		FRP-PV.18-4".00