


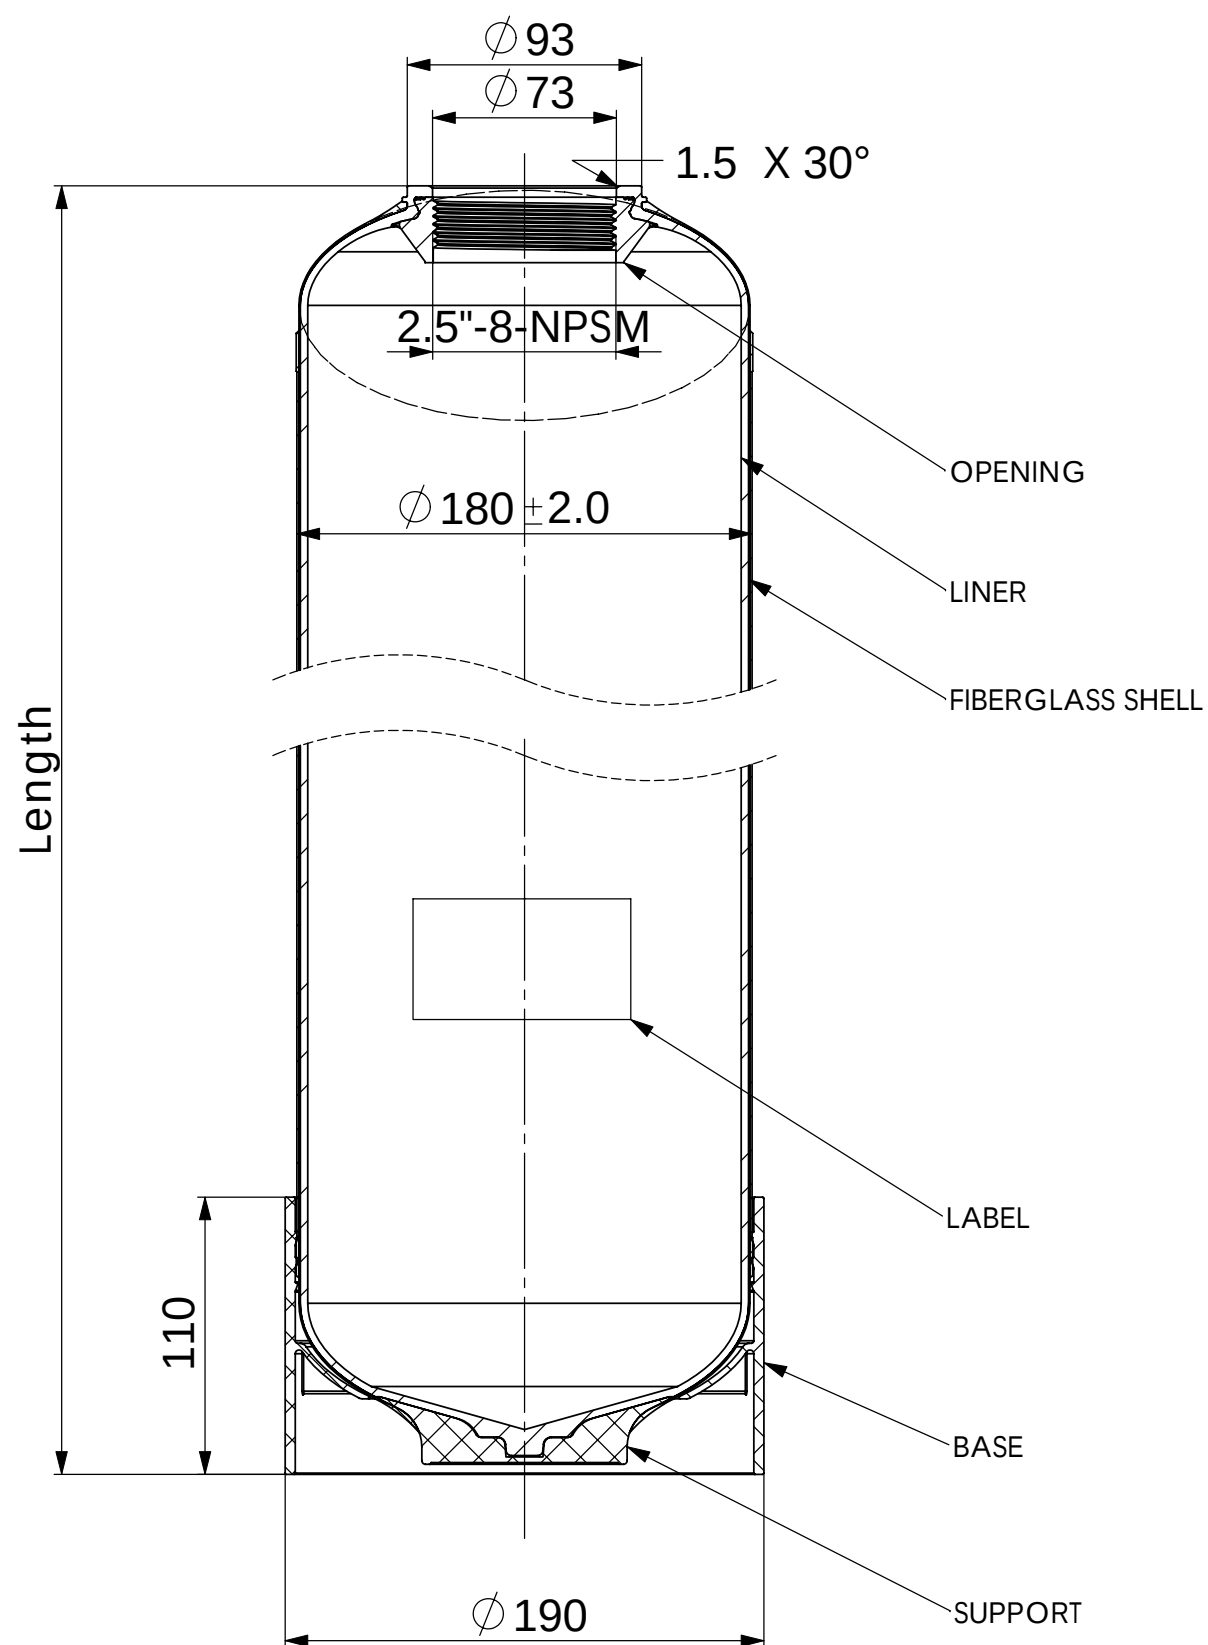

DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
07×13	335	13.2	3	6.3	0.22	1.47	3.23
07×17	437	17.2	4	8.5	0.3	1.72	3.78
07×19	488	19.21	4	9.72	0.34	2.12	4.66
07×22	566	22.3	4	11.43	0.4	2.47	5.43
07×30	768	30.23	4	15.8	0.56	2.67	5.87
07×35	896	35.28	4	19.1	0.68	2.95	6.49
07×44	1123	44.21	4	24.3	0.86	3.67	8.07

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIRMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

				開能 CANATURE GROUP	
				07" FRP PRESSURE VESSEL WITH BASE	
VERSION NO.	DESCRIPTION OF CHANGES:			SIGNATURE	DATE
DESIGNER		STANDARD	STAGE REMARK	NUMBER /SET	SCALE
					1:3
INSPECTION		AUTHORIZATION	PROJECTION	SOURCING FROM:	
TECHNOLOGIST			TOTAL PAGES:	PAGE NO.	