
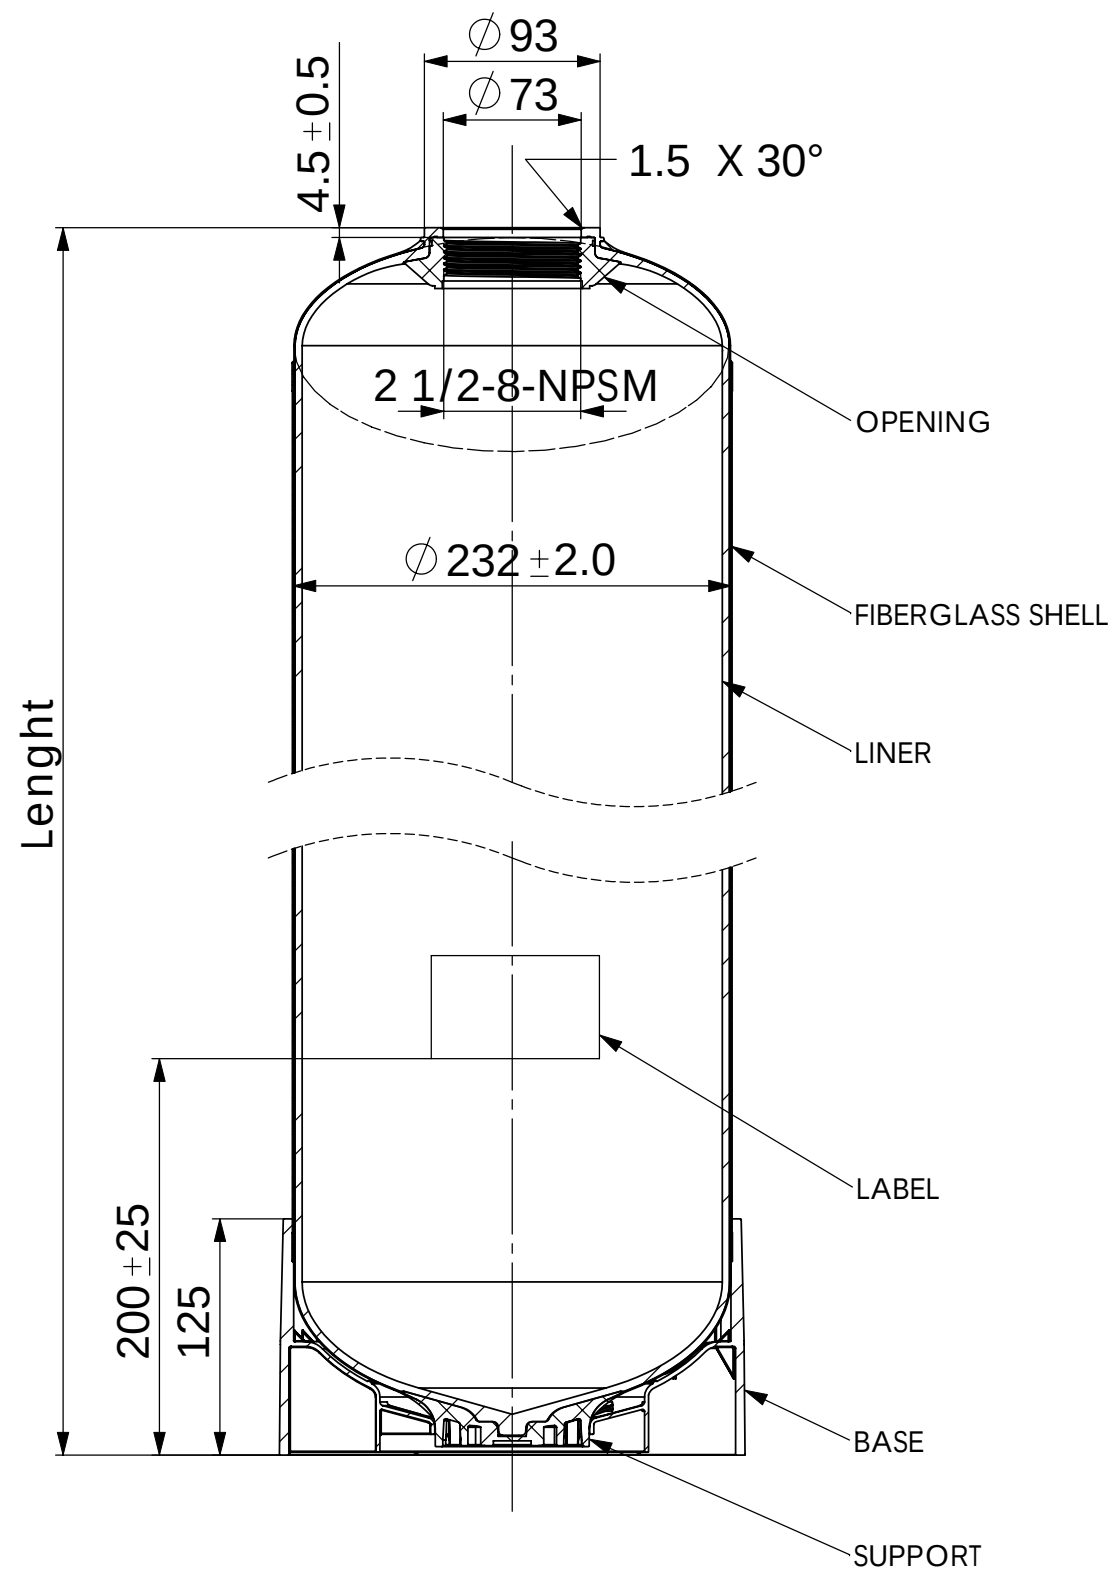




DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
09×15	388	15.28	3	11.8	0.42	2.36	5.192
09×17	439	17.28	4	14	0.49	2.76	6.07
09×18	465	18.31	4	14.8	0.52	2.96	6.51
09×35	898	35.35	4	31.6	1.12	4.66	10.25
09×42	1074	42.28	4	38.5	1.36	5.18	11.4
09×48	1228	48.35	4	44.6	1.58	5.86	12.89

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIRMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

										 CANATURE GROUP
VERSION NO.	DESCRIPTION OF CHANGES:							SIGNATURE	DATE	09" FRP PRESSURE VESSEL With Base
DESIGNER			STANDARD	STAGE REMARK			NUMBER /SET	SCALE	/	
							1	1:4	MATERIAL:	
INSPECTION			AUTHORIZATION	PROJECTION					FRP-PV.09.00	
TECHNOLOGIST				TOTAL PAGES:			PAGE NO.			