
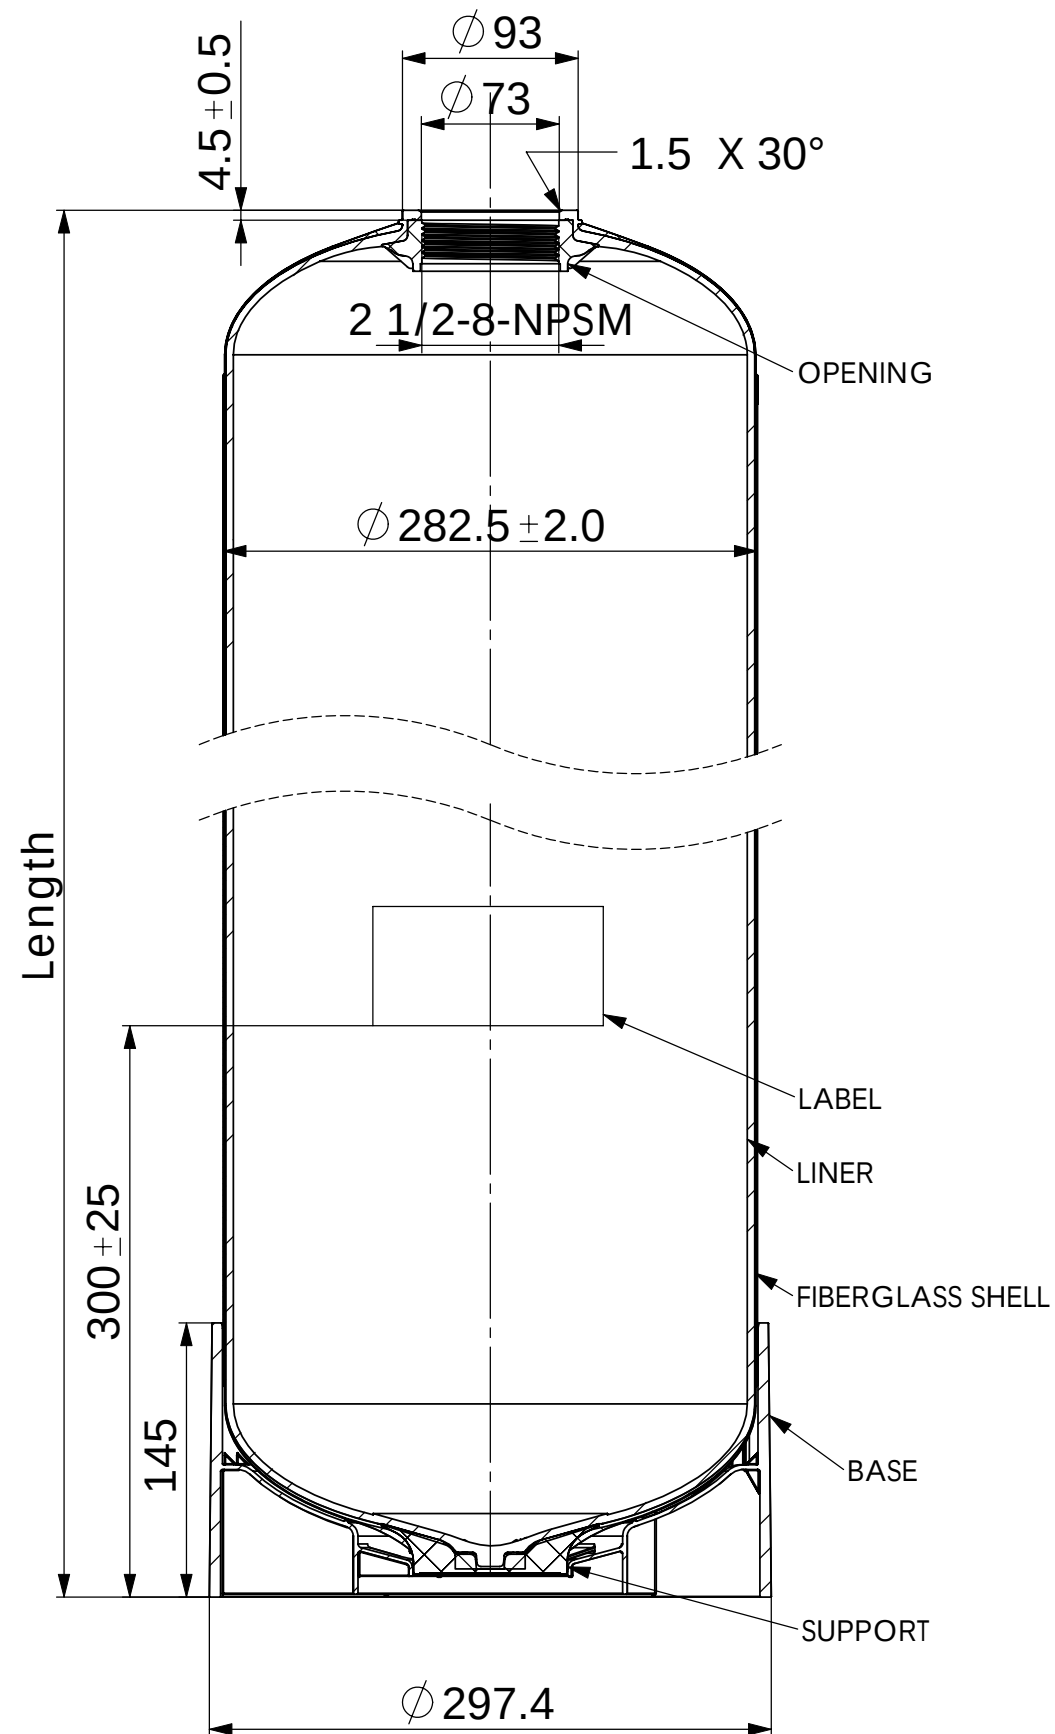




DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
11×35	903	35.5	4	46.7	1.65	5.77	12.69
11×44	1130	44.5	4	59.8	2.11	6.88	15.12

NOTES:

- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
- OPERATING SPECIFICATIONS:
 - MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)
 - TEMPERATURE RANGE - 34-122 °F (1-50 °C)
 - MAXIMUM VACUUM - 5.5"Hg (140mm Hg)
 - MEDIA - WATER
- TEST REQUIRMENT
 - BURST PRESSURE TEST: 4.2MPa
 - CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES
 - HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINS
- VISUAL LINER INSPECTION
 - NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.
 - NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm
 - NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
- ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
- LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

							開能. CANATURE GROUP <i>Canature</i>	
							11" FRP PRESSURE VESSEL with base	
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE		
DESIGNER			STANDARD	STAGE REMARK		NUMBER /SET	SCALE	/
							1:4	MATERIAL:
INSPECTION			AUTHORIZATION	PROJECTION				FRP-PV.11.00
TECHNOLOGIST				TOTAL PAGES:		PAGE NO.		