


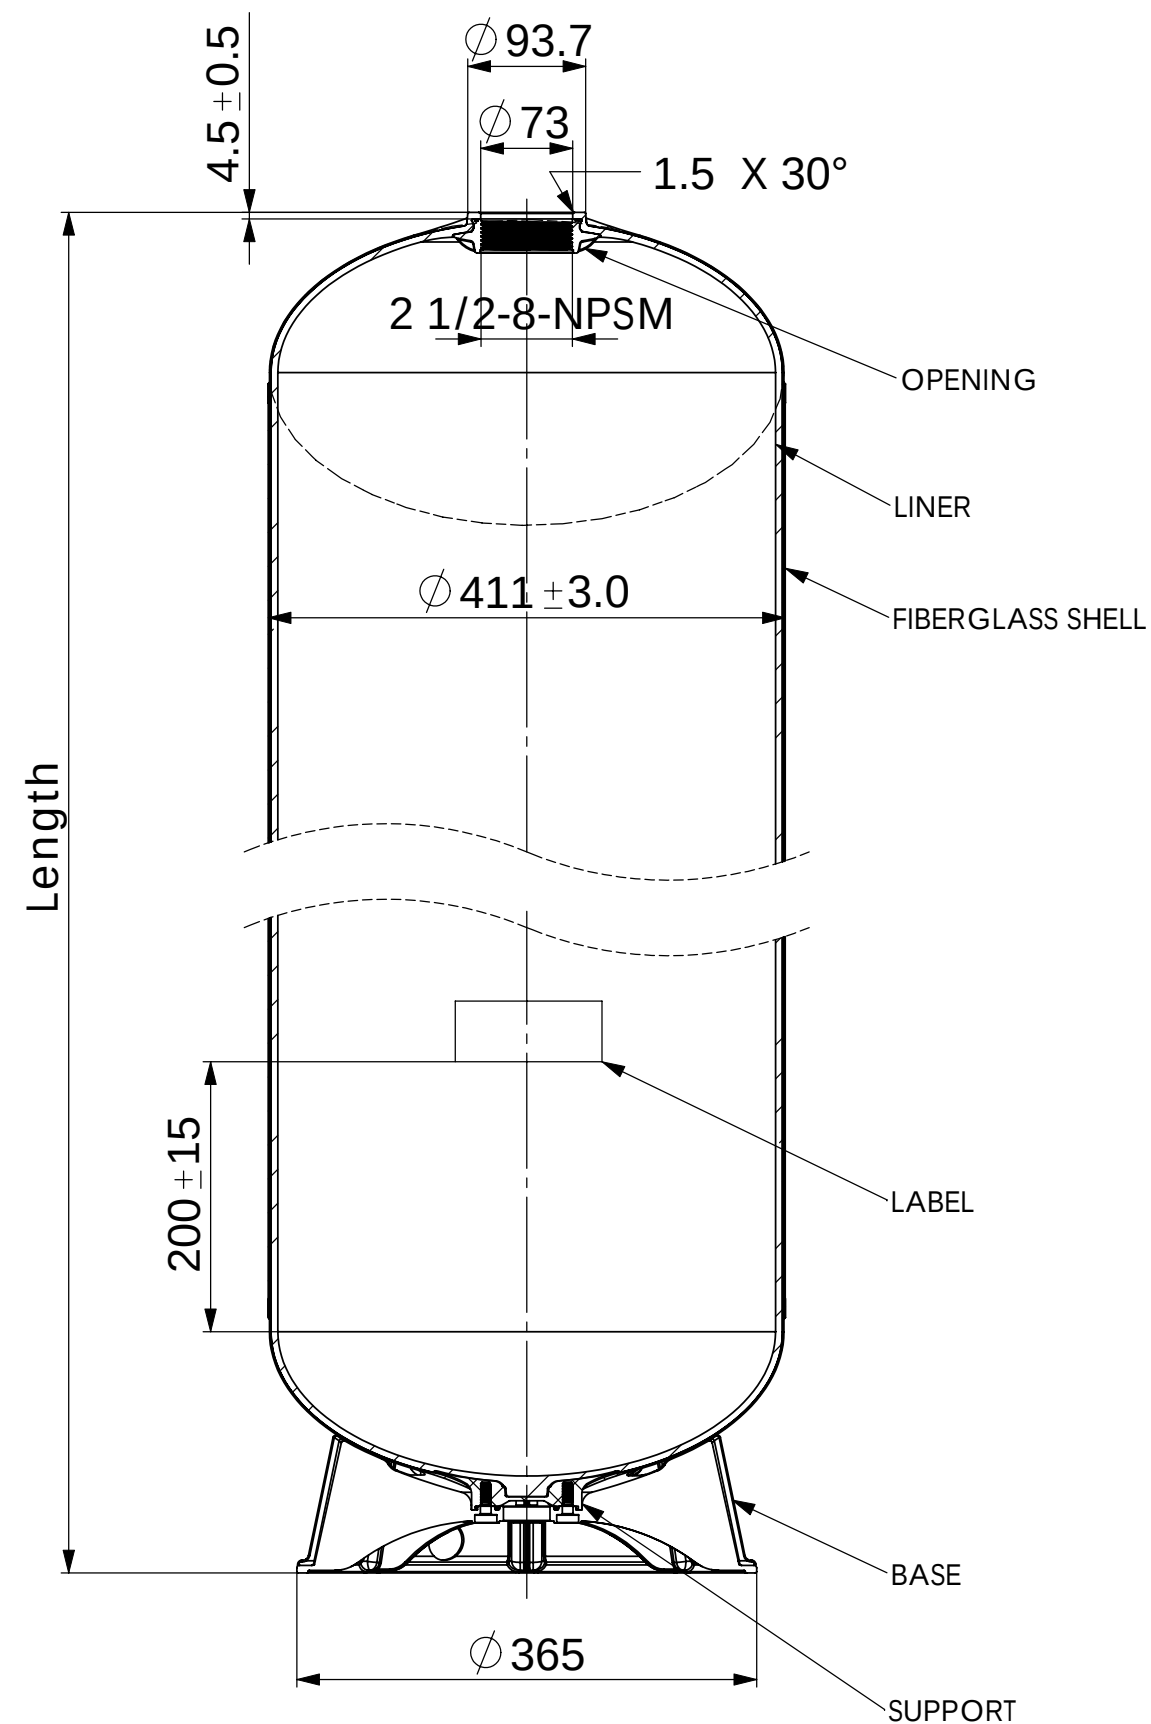

MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
16×24	624	24.57	3	57	2	6.67	14.67
16×36	968	38.11	4	98.1	3.47	11.32	24.9
16×44	1240	48.82	5	131.6	4.65	13.5	29.7
16×52	1377	54.21	5	148.3	5.24	16.42	36.12
16×65	1706	67.16	6	188.6	6.66	19.47	42.83

NOTES:

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
2. OPERATING SPECIFICATIONS:

A. MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)

B. TEMPERATURE RANGE - 34-122 °F (1-50 °C)

C. MAXIMUM VACUUM - 5.5"Hg (140mm Hg)

D. MEDIA - WATER
3. TEST REQUIREMENT

A. BURST PRESSURE TEST: 4.2MPa

B. CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES

C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
4. VISUAL LINER INSPECTION

A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.

B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm

C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
5. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
6. LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

				開能 CANATURE GROUP <i>Canature</i>			
				16" FRP PRESSURE VESSEL (2.5"-8-NPSM Opening) with base			
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATURE	DATE	
DESIGNER		STANDARD	STAGE REMARK		NUMBER /SET	SCALE	/
						1:6	MATERIAL:
INSPECTION		AUTHORIZATION	PROJECTION		SOURCING FROM:		
TECHNOLOGIST			TOTAL PAGES:		PAGE NO.		FRP-PV.16-2.5".00