




AUGUST 4, 2026

PRODUCT UPDATE

NEW “CI” SOFTWARE RELEASE

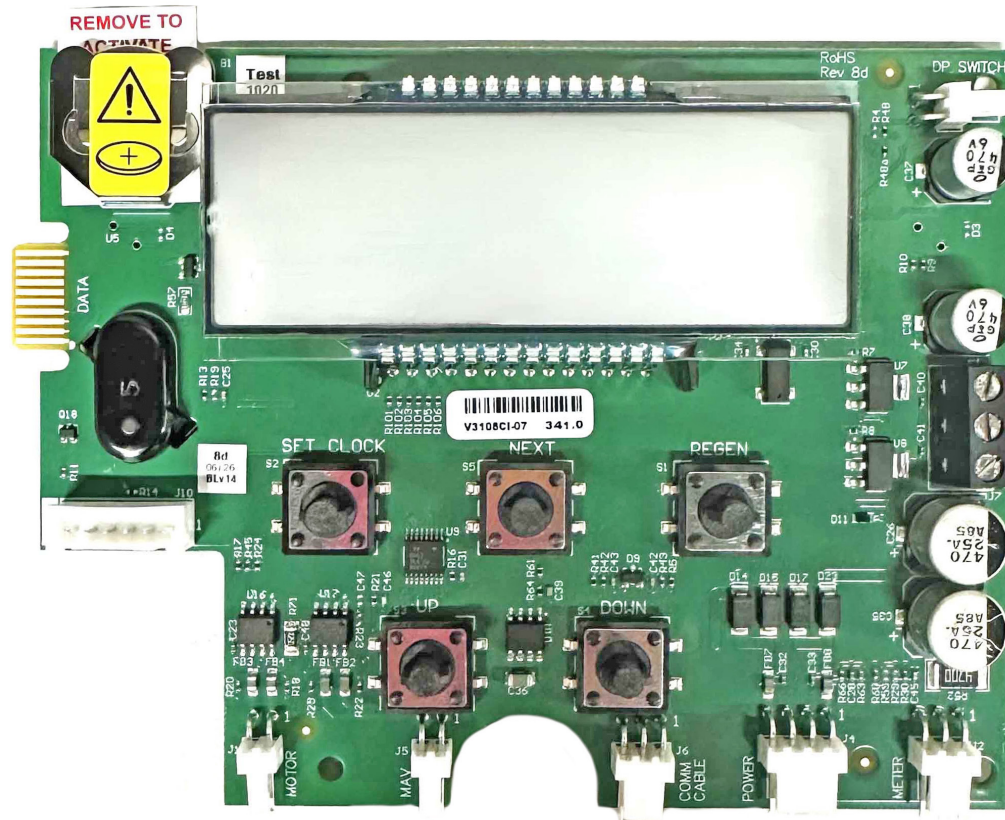

WS1 - WS2QC CI Circuit Board
Order Number: V3108CI-07BOARD

- New CI Software Version 341.0 improves control performance while operating with the 3V battery pull tab installed.
- The default Ionic Capacity for softening was updated to: 1.3 kg for PPM setting, 70 m³ for dH setting, 130 m³ for fH setting.
- When relay 1 or relay 2 was set for “Error” and the Salt Alarm was enabled, the relays would activate when the salt alarm was triggered. The relays should not have been activated in this situation.
- Due to the nature of this update, new configuration files will need to be created.

If you have any questions please contact us. • Thank You • Water Treatment Sales
4462 Duraform Lane • Windsor, WI 53598-9716
Phone (608) 846-3010 • Fax (800) 755-3010