


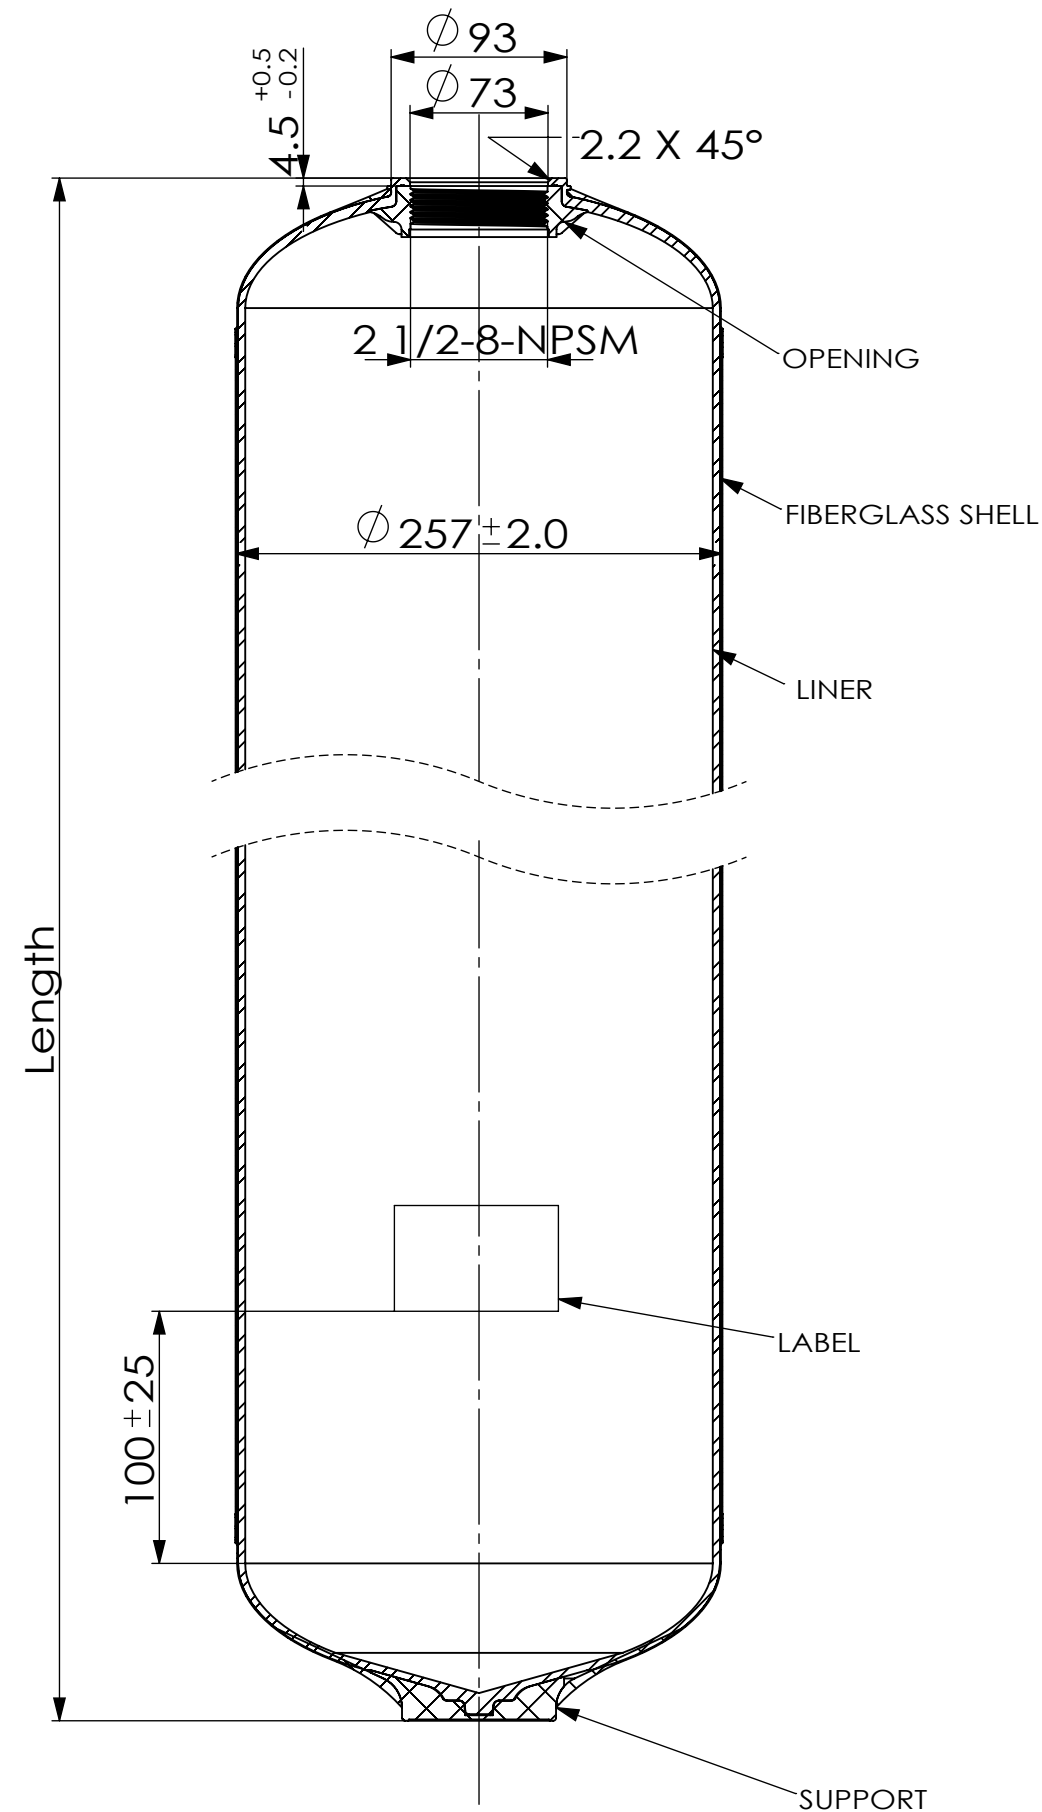

DATA SHEET							
MODEL	Length			VOLUME		WEIGHT	
	mm	inch	+/-	Liters	CU.Ft	Kg	LBS
10×13	331	13.03	3	12.1	0.427	1.8	3.96
10×15	381	15	3	14	0.495	1.98	4.36
10×17	432	17	4	16.5	0.583	2.45	5.39
10×24	606	23.85	4	24.8	0.88	3.3	7.26
10×26	661	26.02	4	27.33	0.97	3.49	7.68
10×30	763	30.04	4	32.28	1.14	4.1	9.02
10×35	891	35.08	4	38.3	1.35	4.34	9.55
10×40	1020	40.16	4	44.65	1.58	5.05	11.11
10×44	1118	44.02	4	48.8	1.72	5.6	12.32
10×47	1195	47.05	4	53.2	1.88	5.95	13.09
10×54	1378	54.25	5	61	2.16	7.1	15.62

NOTES:

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD,LATEST REVISION.
2. OPERATING SPECIFICATIONS:

A. MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR)

B. TEMPERATURE RANGE - 34-122 °F (1-50 °C)

C. MAXIMUM VACUUM - 5.5"Hg (140mm Hg)

D. MEDIA - WATER
3. TEST REQUIRMENT

A. BURST PRESSURE TEST: 4.2MPa


B. CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES

C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs
4. VISUAL LINER INSPECTION

A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS.

B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm

C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED
5. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED
6. LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT

								開能 <i>Canature</i>	CANATURE GROUP
VERSION NO.	DESCRIPTION OF CHANGES:				SIGNATUR	DATE	10" FRP PRESSURE VESSEL		
DESIGNER			STANDARD	STAGE REMARK		NUMBER /SET	SCALE	/	
							1:4	MATERIAL:	
INSPECTION			AUTHORIZATION	PROJECTION				FRP-PV.10.00	
TECHNOLOGIST				TOTAL PAGES:		PAGE NO.			