
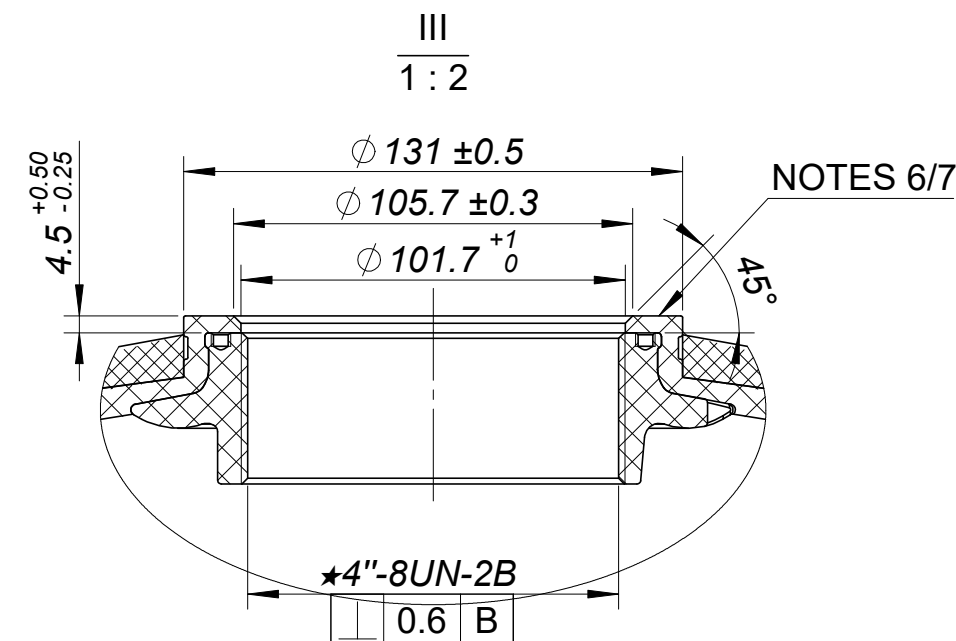



07533072A





MODEL	LENGTH				VOLUME		DOME VOLUME		WEIGHT	
	mm	inch	+/-		Liters	cubic FT	Liters	cubic FT	Kg	LBS
			mm	inch						
KN3072-4T4B	2140	84.25	20	0.79	745	26.3	88.5	3.13	70.5	155.4

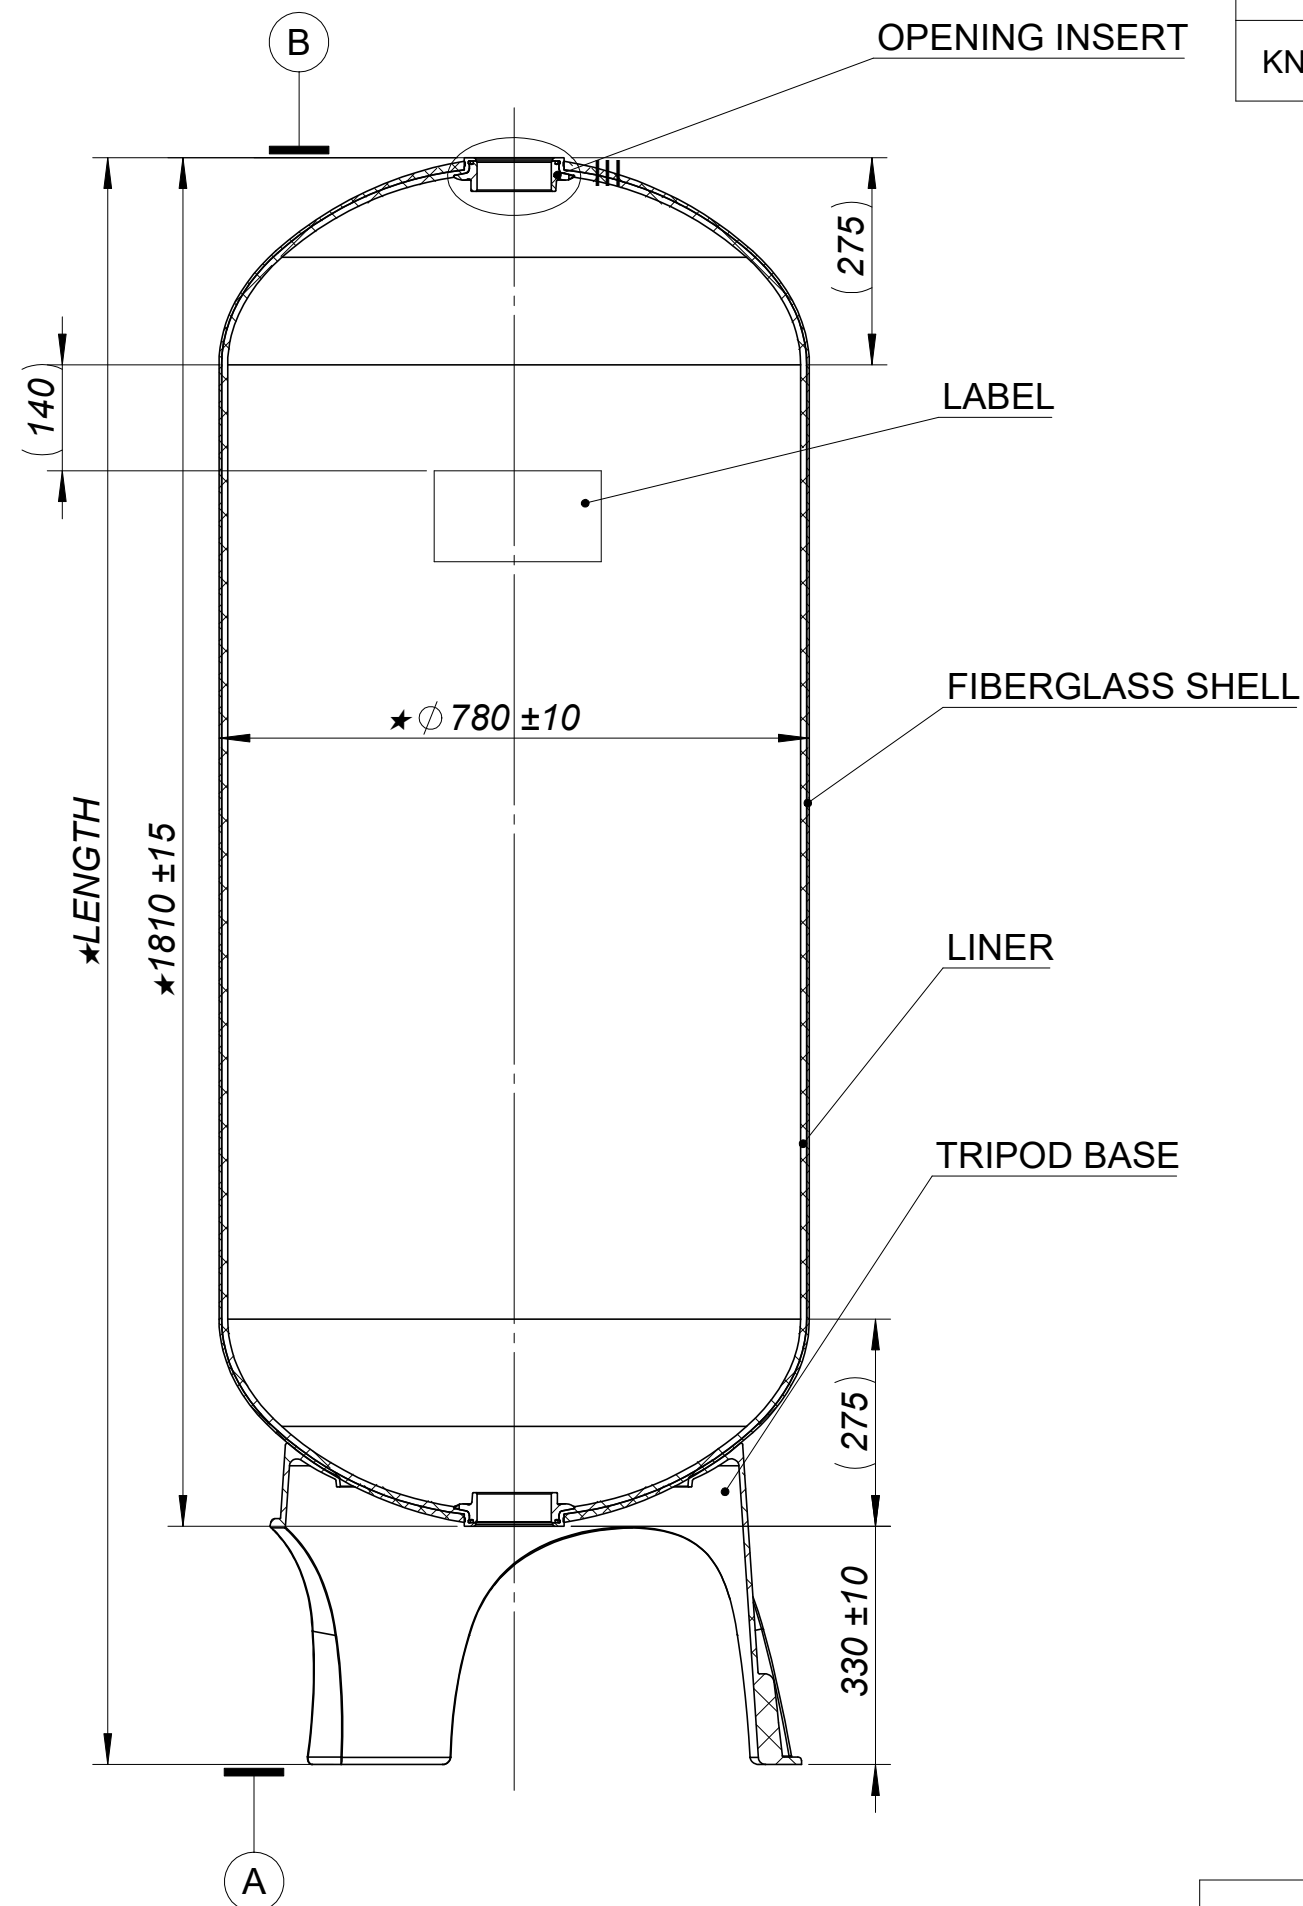


- NOTES:
- TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 44 STANDARD, LATEST REVISION.
 - OPERATING SPECIFICATIONS:
 - A. MAXIMUM WORKING PRESSURE - 150PSI (1.03MPa);
 - B. TEMPERATURE RANGE - 34-120 °F (1-49 °C);
 - C. MAXIMUM VACUUM - 5"Hg (127mm Hg);
 - TEST REQUIREMENT
 - A. BURST PRESSURE TEST: 4.2MPa;
 - B. CYCLIC PRESSURE TEST: 1.04MPa / 100,000 CYCLES ;
 - C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs ;
 - VISUAL LINER INSPECTION
 - A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS;
 - B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm;
 - C. NO INTERNAL BURNT DEBRIS ALLOWED;
 - ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED;
 - SURFACE TO BE FREE OF NICKS, SCRACHES, RESIN AND GLASS;
 - SURFACE FINISH RA1.6-RA3.2;
 - TANK TO BE BONDED TO BASE;
 - USING A STANDARD LEVEL WITH TANK POSITIONED ON A LEVEL SURFACE, DATUM B TO BE PARALLEL WITH DATUM A. BUBBLE OF LEVEL COMPLETELY WITHIN LINES WHEN MEASURED AT 90° INTERVALS;
 - AFTER THE TANK IS LEVELED, IT IS RECOMMENDED THAT THE TANK BE BOLTED TO THE FLOOR IN SIX POSITIONS PER THE TRIPOD BASE BOLT HOLE PATTERN WITH 3/8" ANCHORS;
 - LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT.

THIS PRODUCT DRAWING CAN NOT BE
COPIED AND/OR USED WITHOUT PRIOR
WRITTEN APPROVAL OF CANATURE

										開能. CANATURE GROUP Canature		
										KN3072-4T4B FRP PRESSURE VESSEL		
MARK	PCS	REV.NO		SIGNATURE	DATE	STAGE REMARK		NUMBER /SET	SCALE	07533072A		
DESIGNER			STANDARD				A		1			1:10
INSPECTION			AUTHORIZATION			PROJECTION				SOURCING FROM:		
TECHNOLOGIST						TOTAL PAGES: 2 PAGE NO.1						

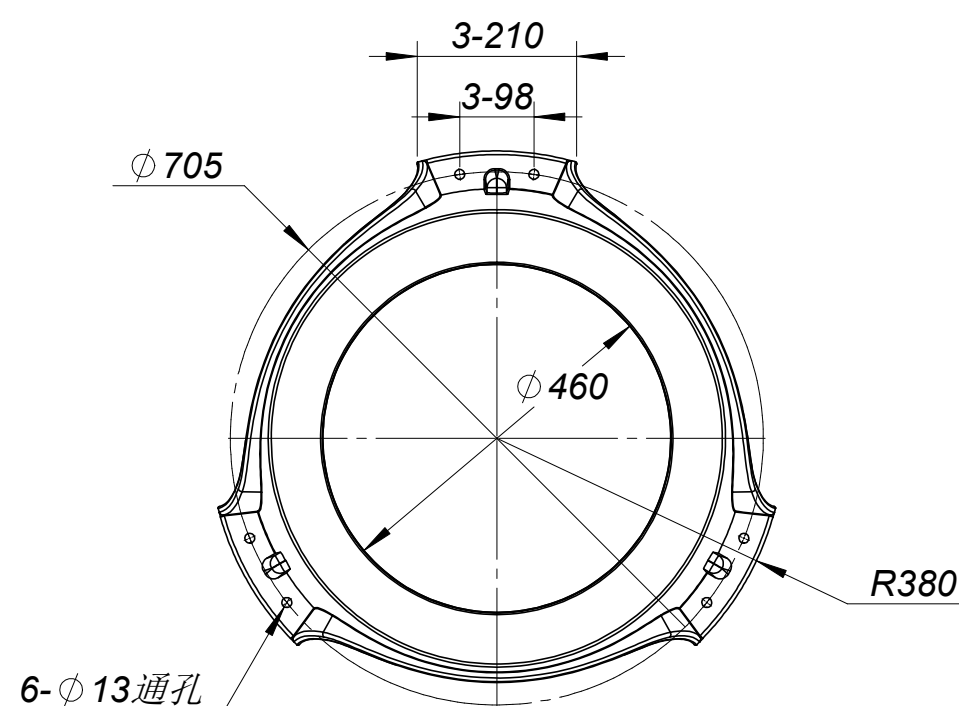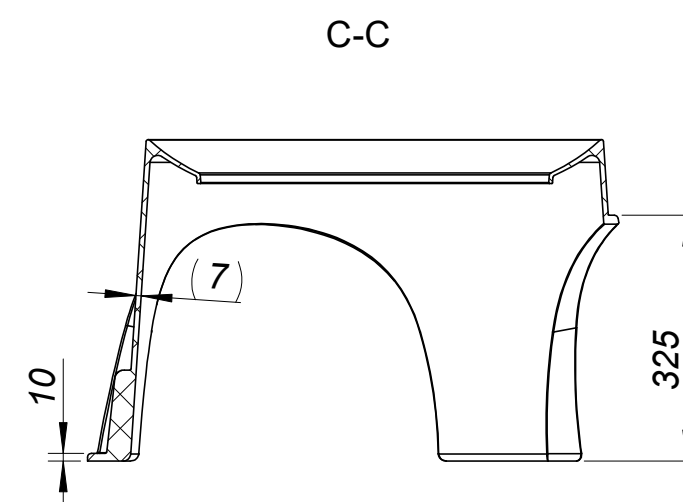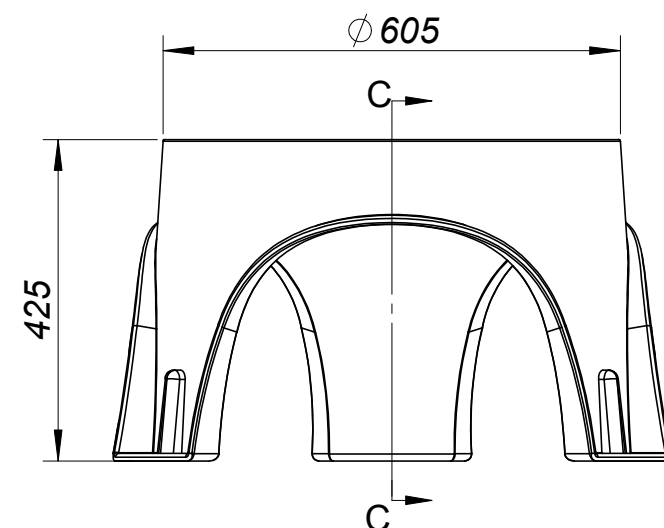

- NOTES:
- 1.LOAD CAPACITY OF THIS BASE IS 2500Kg;
 - 2.BOTTOM SURFACES OF THE THREE FEET OF THE BASE MUST BE LEVELLED;
 - 3.STABLE WITH FRP PRESSURE VESSEL;
 - 4.SURFACE COLOR: BLACK;
 - 5.THE SURFACE IS SMOOTH AND FREE OF SCRATCHES, IMPURITIES AND OTHER DEFECTS;
 - 6.ALL SHARP CORNERS AND EDGES NEED TO BE BLUNT, UNDECLARED FILLET AND CHAMFER ARE R2/C1;

					FIBERGLASS				開能 CANATURE GROUP Canature	
									KN3072-4T4B FRP PRESSURE VESSEL	
MARK	PCS	REV.NO	SIGNATURE	DATE	STAGE REMARK	NUMBER /SET	SCALE			
DESIGNER		STANDARD			A	1	1:10	07533072A		
INSPECTION		AUTHORIZATION			PROJECTION			SOURCING FROM:		
TECHNOLOGIST					TOTAL PAGES: 2 PAGE NO.2					

THIS PRODUCT DRAWING CAN NOT BE
COPIED AND/OR USED WITHOUT PRIOR
WRITTEN APPROVAL OF CANATURE