


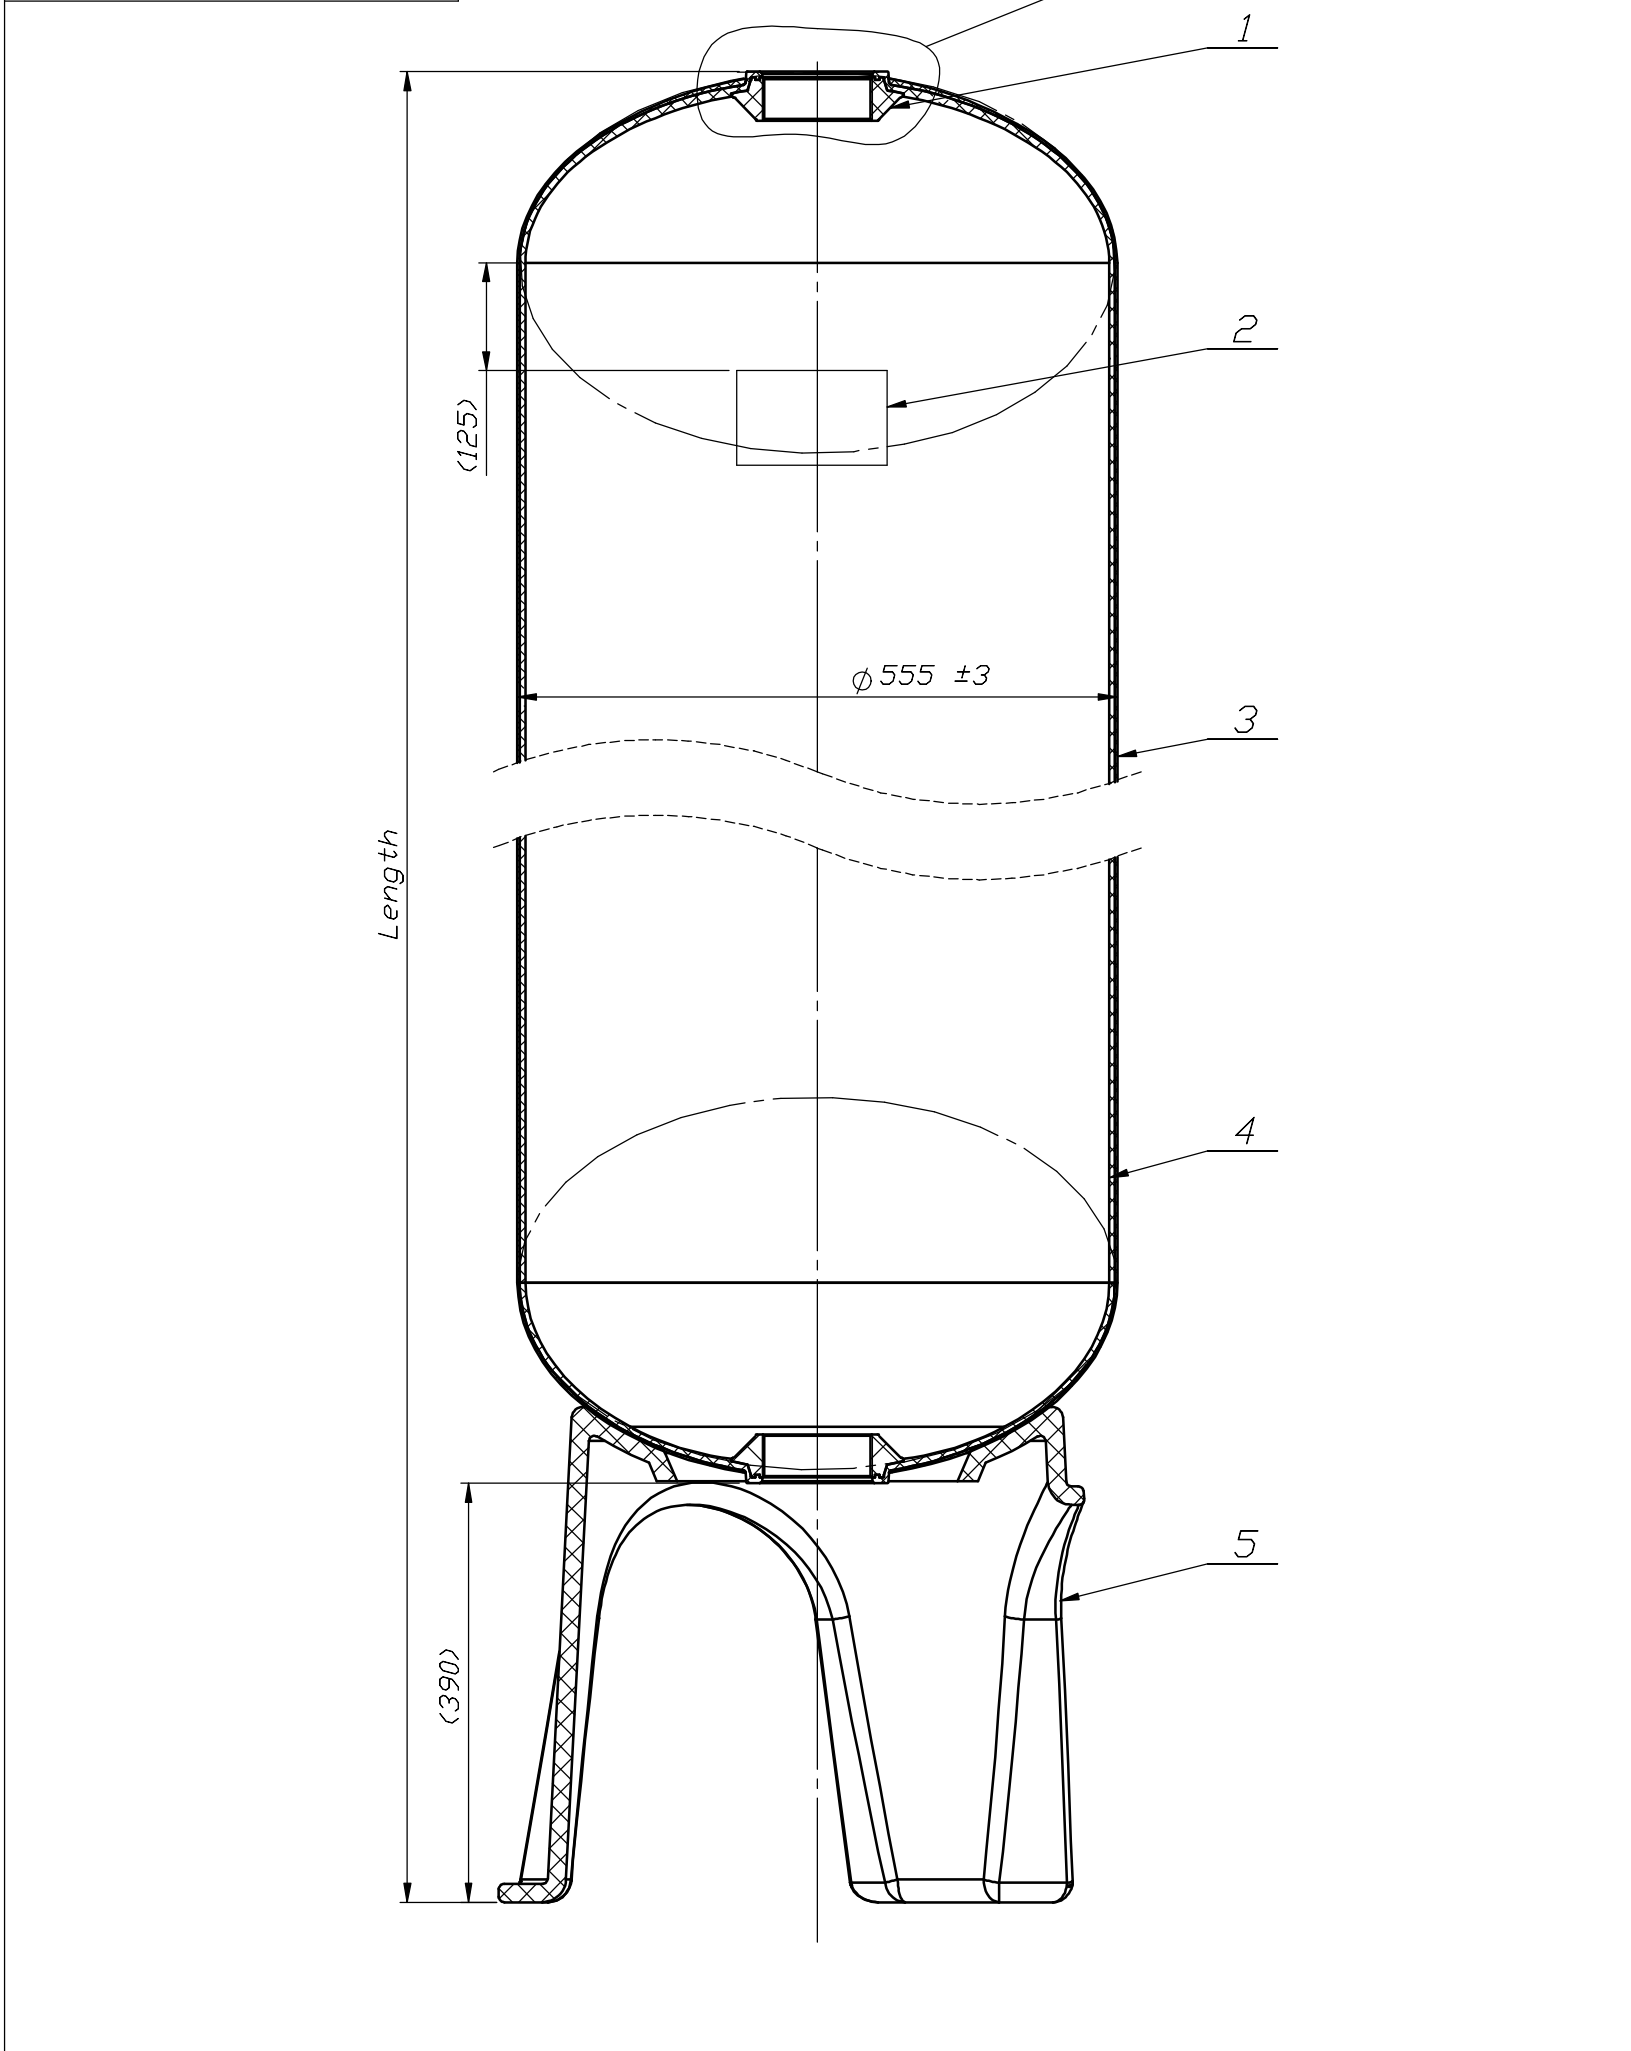

1. TANK MUST MEET ALL APPLICABLE SPECIFICATIONS OF NSF/ANSI 044 STANDARD, LATEST REVISION.
2. OPERATING SPECIFICATIONS:
 - A. MAXIMUM WORKING PRESSURE - 150PSI (10.5BAR);
 - B. TEMPERATURE RANGE - 34-122 °F (1-50°C);
 - C. MAXIMUM VACUUM - 5.5"Hg (140mm Hg);
 - D. MEDIA - WATER
3. TEST REQUIREMENT
 - A. BURST PRESSURE TEST: 4.2MPa;
 - B. CYCLIC PRESSURE TEST: 1.05MPa / 100,000 CYCLES ;
 - C. HYDROSTATIC PRESSURE TEST: 2.52MPa / KEEP 15MINs ;
4. VISUAL LINER INSPECTION
 - A. NO MORE THAN 10 INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS;
 - B. NO INTERNAL OR EXTERNAL BLEMISHES OR BURNT DEBRIS LARGER THAN 3 x 3mm;
 - C. NO INTERNAL BLEMISHES OR BURNT DEBRIS ALLOWED;
5. ALL GLASS STRANDS FROM FIBERGLASS LINER TO BE BONDED AND COVERED;
6. THE PERPENDICULARITY TOLERANCE OF THE AXIS OF THREADED INSERTS AND THE HORIZONTAL PLANE OF THE TANK IS <0.2mm;
7. THE PERPENDICULARITY TOLERANCE OF THE TANK BODY AFTER BEING INSTALLED WITH BASE AND THE GROUND LEVEL IS<5mm;
8. LABEL'S POSITION CAN BE CHANGED WITH THE CUSTOMER'S REQUIREMENT.

開能 CANATURE GROUP
Canature